
Supply Airette with Filters

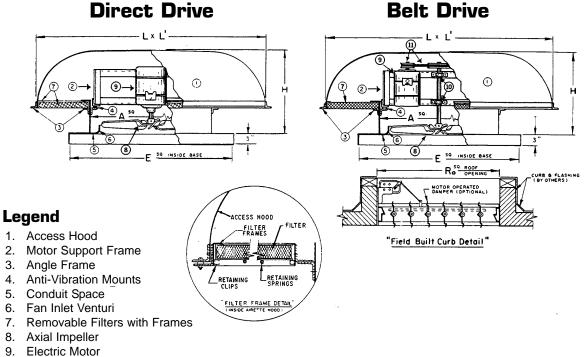

- 10. Fan Shaft & Bearings (Belt Drive Only)
- 11. Belt & Pulleys (Belt Drive Only)

Installing contractors should secure mounting base to roof curbs with lag bolts and washers or other proper fasteners 12" O.C. When hoods are removed from airshafts during erection, installation contractors are cautioned to reset hoods properly with all fasteners drawn fully tight. In areas subjected to high winds, it is recommended that large units be guyed down.

Dimensional Data

	24	30	36	42	48	54	60
L X L'	61 x 61	68 x 76	81 x 91	101 x 101	117 x 121	101 x 161	117 x 167
Н	26	29	29	31	31	37	36
Α	26	32	38	44	50	56	62
Ro	25	31	36	44	50	55	62
E†	35	41	47	53	59	65	71
Filters	8(16 x 25)	6(16 x 25)	4(16 x 20)	14(20X25)	8(16 x 25)	$24(20 \times 25)$	28(20 x 25)
Qty (Size)	0(10 × 23)	2(20 x 25)	8(20 x 25)	14(20/20)	12(20 x 25)	24(20 x 23)	20(20 X 20)

† Outside dimension of curb should be 1 1/2" less than 'E' dimension.

All dimensions in inches.

Material: Galvanized Steel Housing (Aluminum housing available as an option).



Submittal Sheet

Airette

Direct and Belt Drive Axial Flow Propeller Roof Ventilators Supply with Filters

This drawing illustrates our understanding of order requirements. When approved, it represents details for fabrication, as such, PennBarry will not be responsible for revisions in the field or other changes after release for fabrication. Published and protected by PennBarry, Richardson, TX. All rights reserved. May not be reproduced partially or in full without permission from the publisher. No rights conveyed to manufacture partially or in full, use or sell either the method of construction represented or any invention in any way related thereto.