


Tubular Centrifugal Fan - TUB

Roof Mounted - Arrangement 9, Class I & II

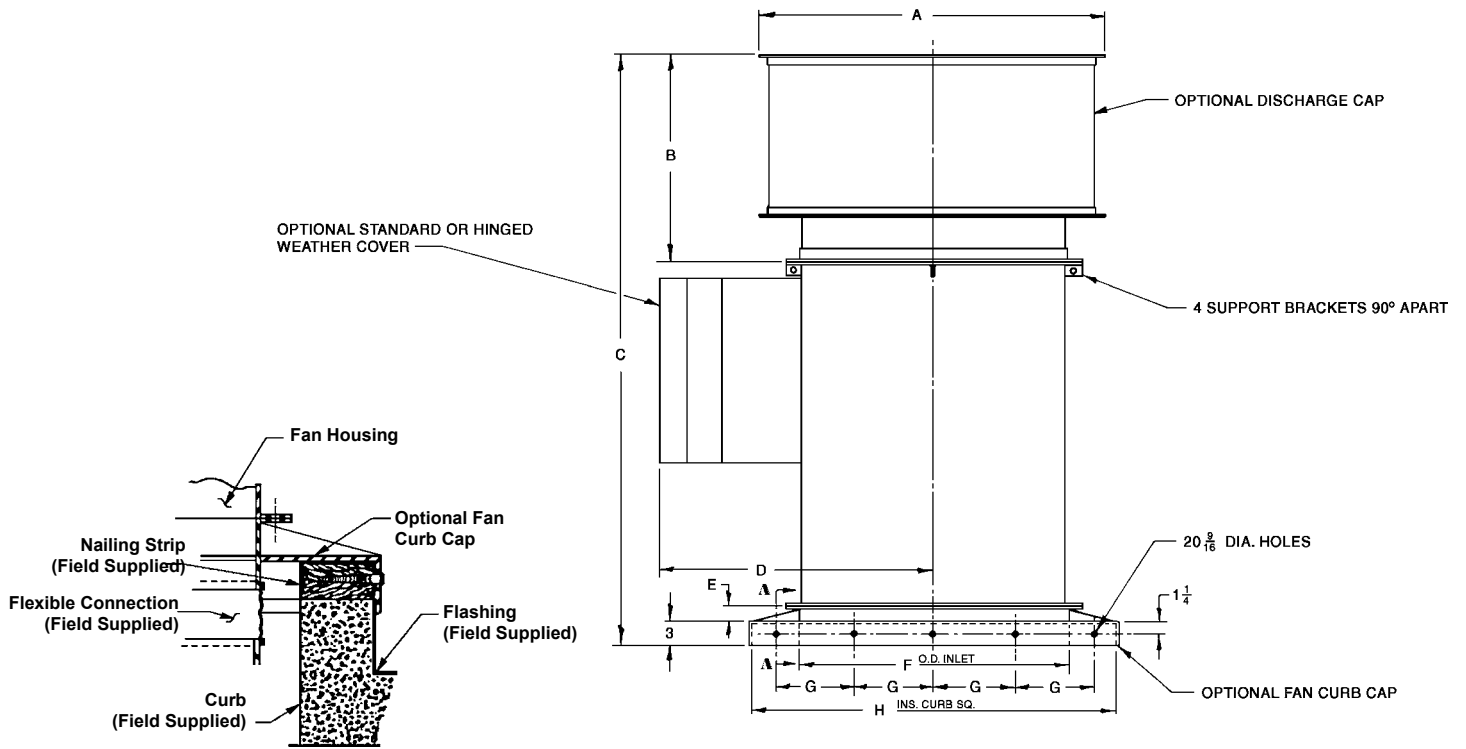

SECTION A-A
Recommended Curb Construction

Notes:

1. All units equipped with adjustable motor base.
2. Guy wire bracing must be provided by the customer when necessary.
3. Dimensions should not be used for construction. Certified drawings are available upon request.

TOLERANCE +/- 1/8 inch

Dimensional Data

Size	Dimensions - Inches											Max Mtr. Frame	
	A	B	C	D	E	F	G	H	J - Dia. Sft.		K		L
									Class I	Class II			
122	24.88	17.50	46.50	26.63	1.25	17.00	5.00	26.63	1.188	1.188	0.56	1.25	184T
135	26.63	18.50	50.13	28.38	1.25	18.75	5.00	28.38	1.188	1.438	0.56	1.25	184T
150	28.63	20.50	55.13	30.38	1.25	20.75	5.00	30.38	1.188	1.438	0.56	1.25	215T
165	30.63	21.50	59.13	32.38	1.25	22.75	5.00	32.38	1.188	1.438	0.56	1.25	256T



PENN BARRY™

1401 North Plano Road, Richardson, TX 75081
Ph: 972.234.3202 Fax: 972.497.0468
www.PennBarry.com

Submittal Sheet

Tubular Centrifugal Fan

Roof Mounted

Arrangement 9, I & II

This drawing illustrates our understanding of order requirements. When approved, it represents details for fabrication, as such, PennBarry will not be responsible for revisions in the field or other changes after release for fabrication. Published and protected by PennBarry, Richardson, TX. All rights reserved. May not be reproduced partially or in full without permission from the publisher. No rights conveyed to manufacture partially or in full, use or sell either the method of construction represented or any invention in any way related thereto.